


WATEROUS

Form Number: F-3063

Issue Date: Jun 16, 2025

CX Series Fire Pump

Operation and Maintenance

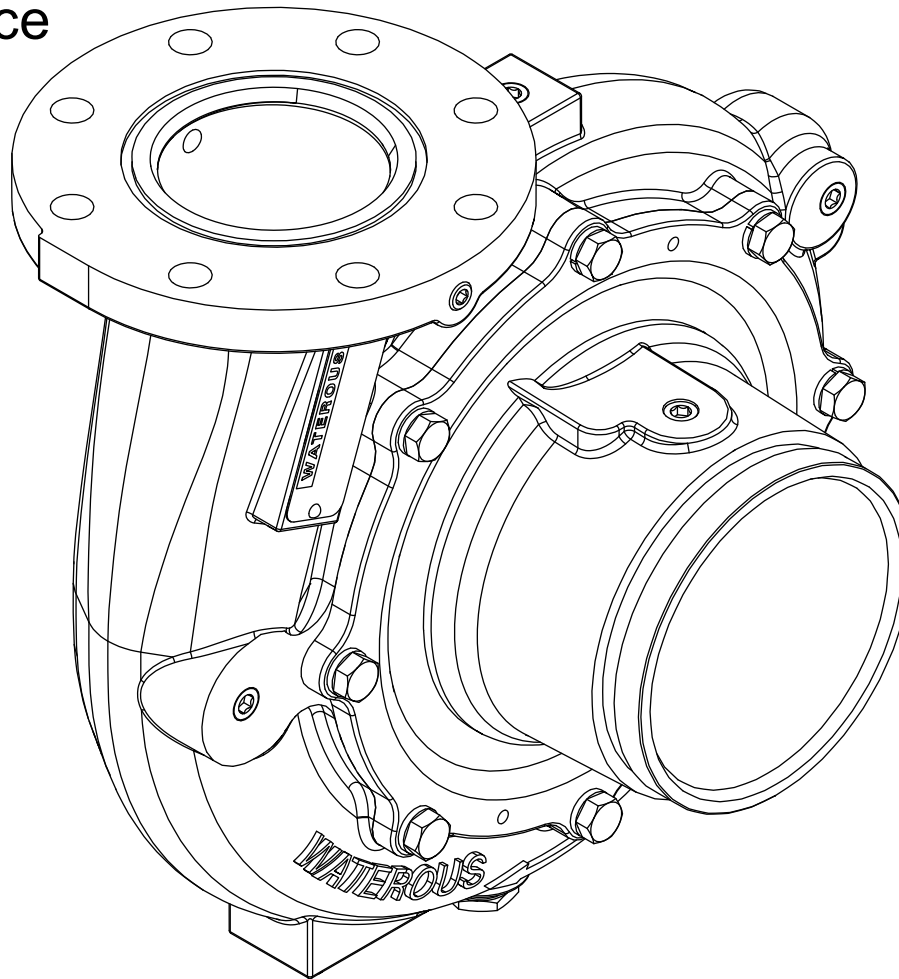

Waterous Company • 125 Hardman Avenue South • South Saint Paul, MN 55075 • (651) 450-5000

www.waterousco.com


Table of Contents


Safety	4
Safety Precautions	4
Introduction	6
Using this Document	6
Viewing the Document Electronically	6
Printing the Document	6
Additional Documentation	6
Overview	7
CX Series Drive Configurations	7
Operation	8
Pumping from the On-Board Tank	8
Pumping from Hydrant or Relay	9
Pumping from Draft	10
Storing the Pump	11
Maintenance	12
Maintenance Schedule	12

Safety Precautions

- Read and understand all the associated documentation before you begin operating the product.
- Contact Waterous when you have questions about operating or maintaining the equipment.
- Read and understand all the notices and safety precautions.
- Do not operate the equipment when safety guards are removed.
- Do not modify the equipment.

Understand that each application is unique. Options included or not included with your application determine the operation of your specific system. It is incumbent upon the operators to develop operational protocols that include robust safety considerations and industry best practices before operating the system. Use the information in this instruction to guide you in developing operating protocols for your application.

! WARNING	
Sudden Unexpected Movement <ul style="list-style-type: none"> • Unexpected movement can cause injury or death. • Make sure the shift unit is in the proper mode before operation. 	

! WARNING	
Hot Liquid <ul style="list-style-type: none"> • Hot liquid can scald you. • Do not operate if water temperature exceeds 160°F (71°C). 	

! WARNING	
High Pressure <ul style="list-style-type: none"> • Discharge ejected at high pressure can cause serious injury and damage. • Direct discharge away from people and equipment. 	

! WARNING	
Hot Surface <ul style="list-style-type: none"> • Hot surfaces can burn you. • Do not touch the surface during operation—allow it to cool after operating. 	

! WARNING	
High Pressure <ul style="list-style-type: none"> • Liquid ejected at high pressure can cause serious injury. • Do not operate beyond recommended pressure. 	

! Read and understand all instructions following this symbol.

Safety Precautions

Read and understand all Notices to provide the best performance in your application and to prevent premature service requirements.

NOTICE

Before Operation


- Read and understand all the instructions provided.
- Check all fluid levels and replenish if necessary.
- Remove all shipping plugs and install the operation plugs or caps.



NOTICE

Freeze Damage


- Do not allow fluid in the lines to freeze.
- Remove all freezable fluid from the lines before storing the apparatus.



NOTICE

Maintenance


- Not following maintenance procedures can damage your equipment.
- Perform all maintenance procedures as required.



NOTICE

Priming Pump Damage


- Do not prime the pump for more than 1 minute.
- Operating the priming pump longer than 1 minute can damage the motor or the motor solenoid.



NOTICE

Pump Damage

- Storing the pump partially full causes undesirable corrosion.
- Always store the pump completely full or empty.



NOTICE

Pump Damage

- Pump damage occurs when operating without adequate water supply.
- Do not operate the pump without adequate water supply.



Read and understand all notices following this symbol.

Use this document to install and operate your Waterous equipment. Understand the following conditions before continuing with the document:

- The instructions may refer to options or equipment that you may not have purchased with your system.
- The illustrations in this document are intended to convey concepts. Do not use the illustrations to determine physical attributes, placement, or proportion.
- Understand that your application may require additional steps, that are not described in the illustrations or instructions, to perform the installation.
- The equipment described in this document is intended to be installed by a person or persons with the necessary skills and knowledge to perform the installation.
- The equipment described in this document is intended to be operated by a person or persons with the basic knowledge of operating similar equipment.
- The information in this document is subject to change without notice.

This document is divided into the following sections:

SAFETY

This section describes general precautions and alert symbols in this document.

INTRODUCTION

This section is an overview of the document.

OVERVIEW

This section describes the components that make up the system.

OPERATION

This section describes the equipment operation.

MAINTENANCE

This section describes maintenance procedures.

Using this Document

Use the guidelines below when viewing this document.

Viewing the Document Electronically

- View this document in landscape orientation.
- Use the table of contents to navigate directly to that section.
- Text **with this appearance** is linked to a reference.

Printing the Document


- The document is best viewed when printed on both sides and in color.
- Use a 3-ring binder to store the document.

Additional Documentation


Additional documentation is available through the MyWaterous login at [Waterousco.com](https://www.waterousco.com). Use your serial number to gain access to the service parts list associated with your system. Dimensional drawings are available through the Waterous Service department.

CX Series Drive Configurations


The CX series pump is available with the following drive options. Know that each application is unique. Some applications use a shift unit to operate the pump, other applications are drive the pump directly. Use the additional resources provided by Waterous to develop an operational procedure specific to your application.

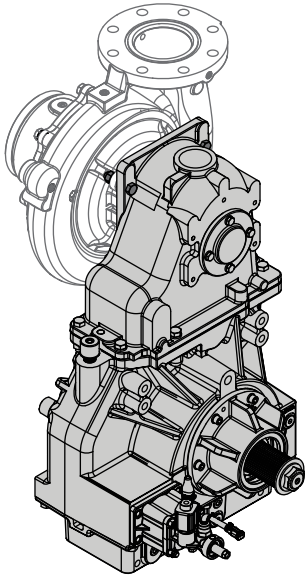


CX with C22 Transmission

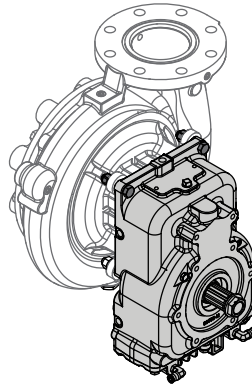


CX with K Transmission

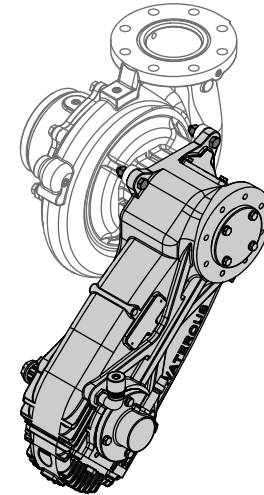


CX with PA Transmission

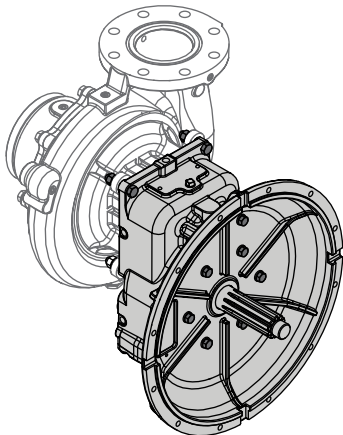

CX with T Transmission

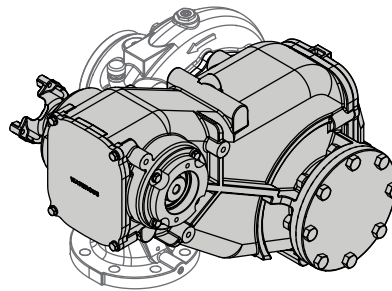


CX with QB Transmission

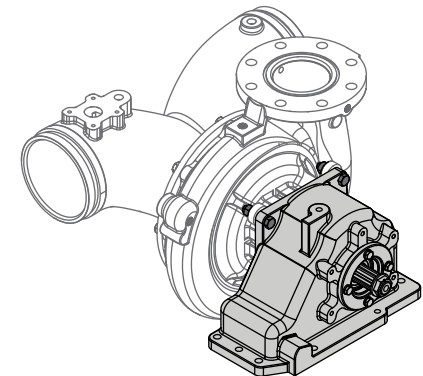



CX with Direct Drive

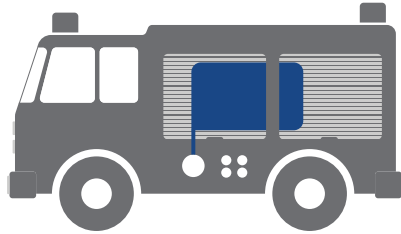
Pumping from the On-Board Tank



Follow the instructions to operate the pump from the on-board tank.


 **High Pressure Hazard:** Prior to connection of hoses, caps, or other closures with pump intake or pump discharge connections, relieve pressure by opening drains.

 **Scalding Water Hazard:** When operating the pump, be sure to open at least one discharge valve slightly to prevent the pump from overheating. If the pump runs for a few minutes completely closed, it may heat the water enough to scald someone when the valve is opened. Overheating can damage the seals and other pump parts. If the apparatus builder has installed a bypass system or other provision designed to prevent overheating, opening a discharge valve may be unnecessary.


 **Unexpected Truck Movement:** Failure to properly shift transmission in accordance with the transmission operating instructions may result in unexpected truck movement which may result in serious personal injury or death.

1. Engage the pump—refer to the pump transmission instructions for your application.
2. Open valve(s) in piping between water tank and pump.
3. Allow about 30 seconds for water to flow into pump.


NOTE: Priming the pump may be necessary because of air trapped in piping.

 **Priming the Pump Damage:** Do not pump the for more than 1 minute. Priming the pump for more than 1 minute can damage the priming motor or solenoid.

4. Open discharge valves and accelerate engine to obtain desired discharge pressure and capacity.
5. Set relief valves or other pressure governing device to desired pressure.


 **Pump Damage:** Do not operate the pump without adequate water supply. Pump damage occurs when operating without adequate water supply.

After operation do the following:

 **High Pressure Hazard:** Prior to removal of hoses, caps, or other closures with pump intake or pump discharge connections, relieve pressure by opening the drains.

1. Disengage the pump—refer to the pump transmission instructions for your application.
2. If pumping other than clean water during operation, flush the pump until all contaminants are removed.
3. Close all drains and install intake and discharge caps.

Pumping from Hydrant or Relay

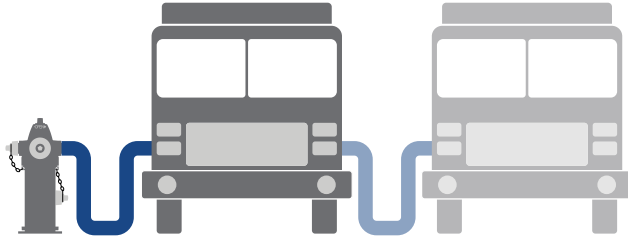

Follow the instructions to operate the pump from hydrant or relay.

High Pressure Hazard: Prior to connection of hoses, caps, or other closures with pump intake or pump discharge connections, relieve pressure by opening drains.

Scalding Water Hazard: When operating the pump, be sure to open at least one discharge valve slightly to prevent the pump from overheating. If the pump runs for a few minutes completely closed, it may heat the water enough to scald someone when the valve is opened. Overheating can damage the seals and other pump parts. If the apparatus builder has installed a by-pass system or other provision designed to prevent overheating, opening a discharge valve may be unnecessary.

Unexpected Truck Movement: Failure to properly shift transmission in accordance with the transmission operating instructions may result in unexpected truck movement which may result in serious personal injury or death.

1. Engage the pump—refer to the pump transmission instructions for your application.
2. Open intake, hydrant, and other valves as necessary to allow water to enter the pump.

NOTE: Bleeder valves should be used while filling a hose connected to an intake with water.

3. Open discharge valves and accelerate engine to obtain desired discharge pressure and capacity.

4. Set relief valves or other pressure governing device to desired pressure.


NOTE: Do not attempt to pump more water than is available from the hydrant. Always make sure the intake pressure compound gauge reading stays above zero. Some fire departments operate at a minimum intake pressure of 10 psi (0.7 bar) when pumping from hydrant to prevent a “soft” intake hose from collapsing.

After operation do the following:

High Pressure Hazard: Prior to removal of hoses, caps, or other closures with pump intake or pump discharge connections, relieve pressure by opening the drains.

1. Disengage the pump—refer to the pump transmission instructions for your application.
2. If pumping other than clean water during operation, flush the pump until all contaminants are removed.
3. Close all drains and install intake and discharge caps.

Pumping from Draft

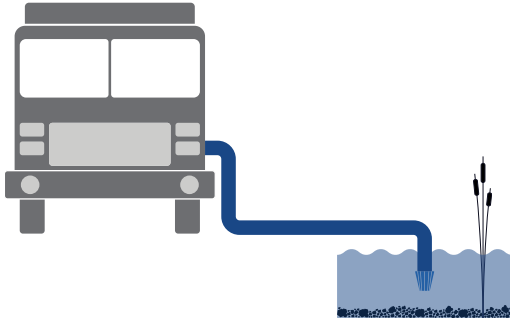

Follow the instructions to operate the pump from draft.

High Pressure Hazard: Prior to connection of hoses, caps, or other closures with pump intake or pump discharge connections, relieve pressure by opening drains.

Scalding Water Hazard: When operating the pump, be sure to open at least one discharge valve slightly to prevent the pump from overheating. If the pump runs for a few minutes completely closed, it may heat the water enough to scald someone when the valve is opened. Overheating can damage the seals and other pump parts. If the apparatus builder has installed a by-pass system or other provision designed to prevent overheating, opening a discharge valve may be unnecessary.

Unexpected Truck Movement: Failure to properly shift transmission in accordance with the transmission operating instructions may result in unexpected truck movement which may result in serious personal injury or death.

1. Position vehicle as near as possible to water supply.
2. Avoid humps and sharp bends in intake hose. Make sure no part of hose is higher than pump intake inlet. Air pockets in intake hose may cause loss of prime or erratic pump action, and may reduce pump capacity.
3. Make sure all intake connections are tight and discharge valves are closed.
4. Immerse intake strainer at least two feet below water surface to prevent pump from drawing air. Whirlpools forming above intake strainer indicate that the strainer is too close to the surface of the water.
5. Make sure intake strainer is far enough from the bottom to prevent sand, gravel, and other foreign matter from being drawn into the pump.


6. Open discharge valves and accelerate engine to obtain desired discharge pressure and capacity.
7. Set relief valves or other pressure governing device to desired pressure.

After operation do the following:

High Pressure Hazard: Prior to removal of hoses, caps, or other closures with pump intake or pump discharge connections, relieve pressure by opening the drains.

1. Disengage the pump—refer to the pump transmission instructions for your application.
2. If pumping other than clean water during operation, flush the pump until all contaminants are removed.
3. Close all drains and install intake and discharge caps.

Storing the Pump

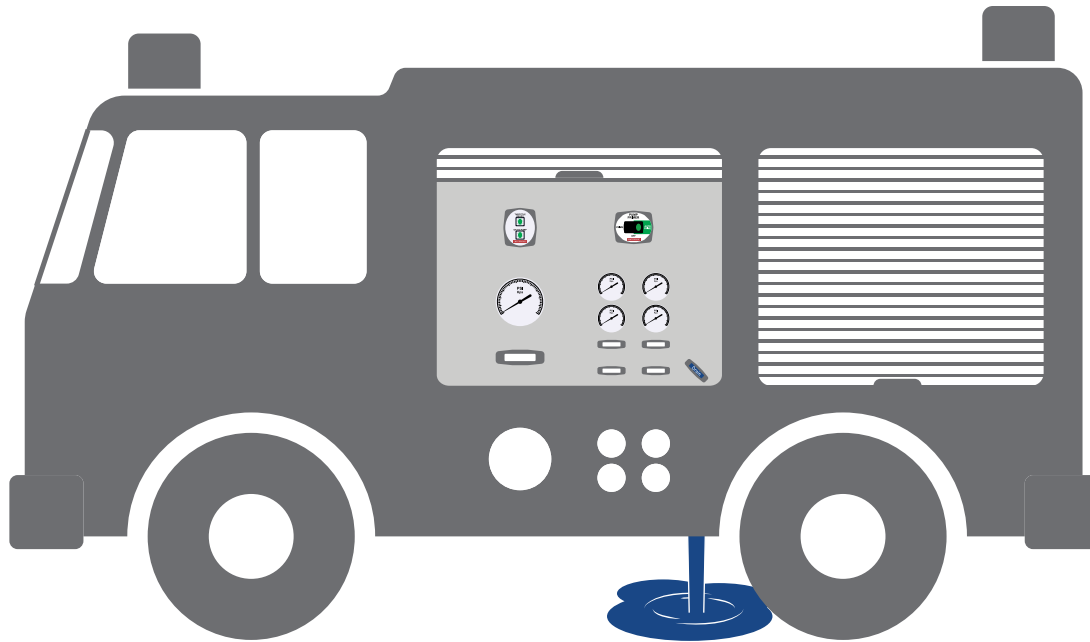

Use the illustration and instructions when storing the pump.

When storing the apparatus, do the following:

- Do not store the pump partially filled with fluid. Either fill the pump fully, or drain the pump completely.

! Pump Damage: *Never store the pump partially full. Always store the apparatus with the pump completely full or completely empty.*

- Drain all fluids from the system when freezing conditions exist.

! Freeze Damage: *Do not allow fluid in the lines to freeze. Use the master drain valve to drain any freezable fluid before storing the apparatus when freezing is possible.*

Maintenance Schedule

No schedule maintenance is required for the pump. However, your system may include optional equipment that requires maintenance. Refer to the instructions included with the optional equipment to create a maintenance schedule.

Notes

WATEROUS

Waterous Company
125 Hardman Avenue South
South Saint Paul, MN 55075
(651) 450-5000
www.waterousco.com